

The Department of Energy has published updated energy efficiency metrics for central air conditioners and heat pumps. This publication reflects both the 1987 metric (SEER) and the 2023 metric (SEER2). Efficiency requirements are published at 10 C.F.R. 430.32(c). Please refer to [www.AHRInet.org](http://www.AHRInet.org) for more information about updated energy efficiency metrics.



U.S. Government

Federal law prohibits removal of this label before consumer purchase.

# ENERGYGUIDE

Heat Pump  
Cooling and Heating  
Split System

GENERALLUX  
Model TSC-GL-12HA2/I3TO23

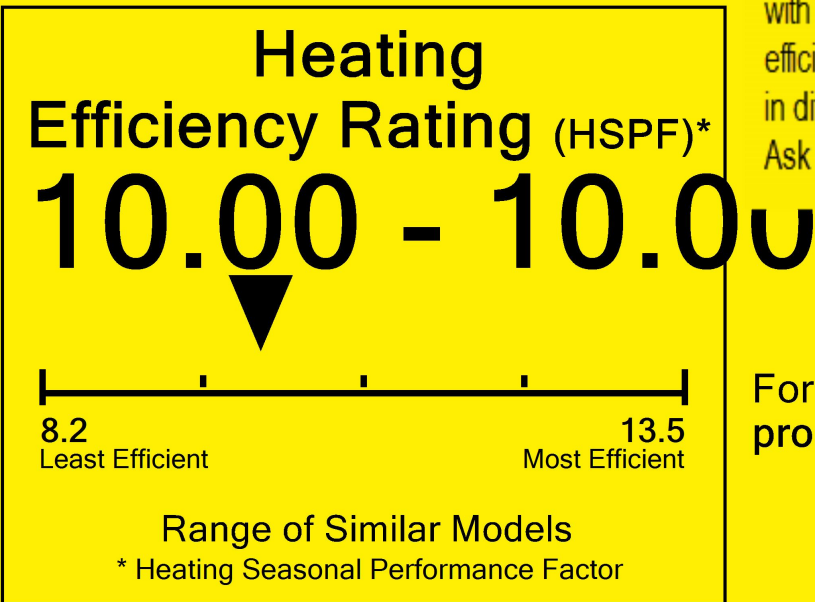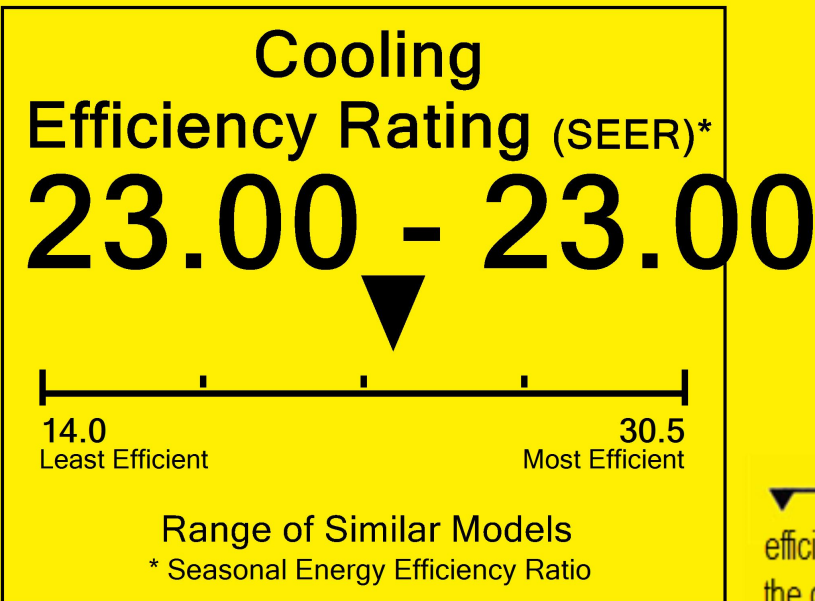

▼ This system's efficiency ratings depend on the coil your contractor installs with this unit. The heating efficiency rating varies slightly in different geographic regions. Ask your contractor for details.

For energy cost info, visit [productinfo.energy.gov](http://productinfo.energy.gov)



U.S. Government

Federal law prohibits removal of this label before consumer purchase.

# ENERGYGUIDE

Heat Pump  
Cooling and Heating  
Split System

GENERALLUX  
Model TSC-GL-12HA2/I3TO23

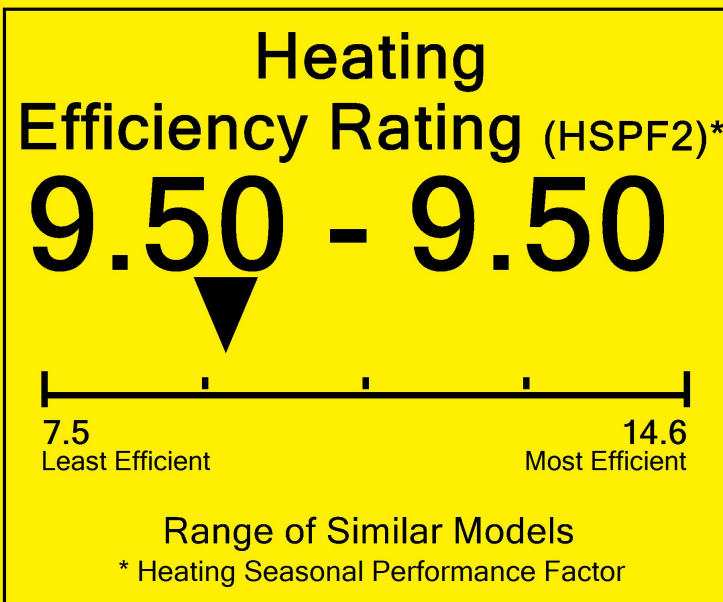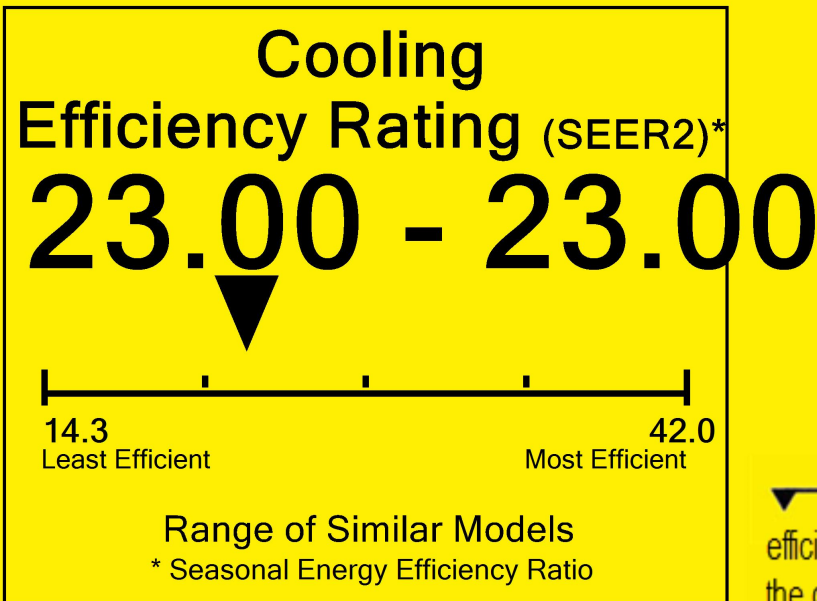

▼ This system's efficiency ratings depend on the coil your contractor installs with this unit. The heating efficiency rating varies slightly in different geographic regions. Ask your contractor for details.

For energy cost info, visit [productinfo.energy.gov](http://productinfo.energy.gov)